


**ELECTRICAL NOTES:**

POWER SERVICE REQ'D:  
100-240VAC 50/60HZ, 15A, NEUTRAL, GROUND  
ALL CONDUIT BY OTHERS

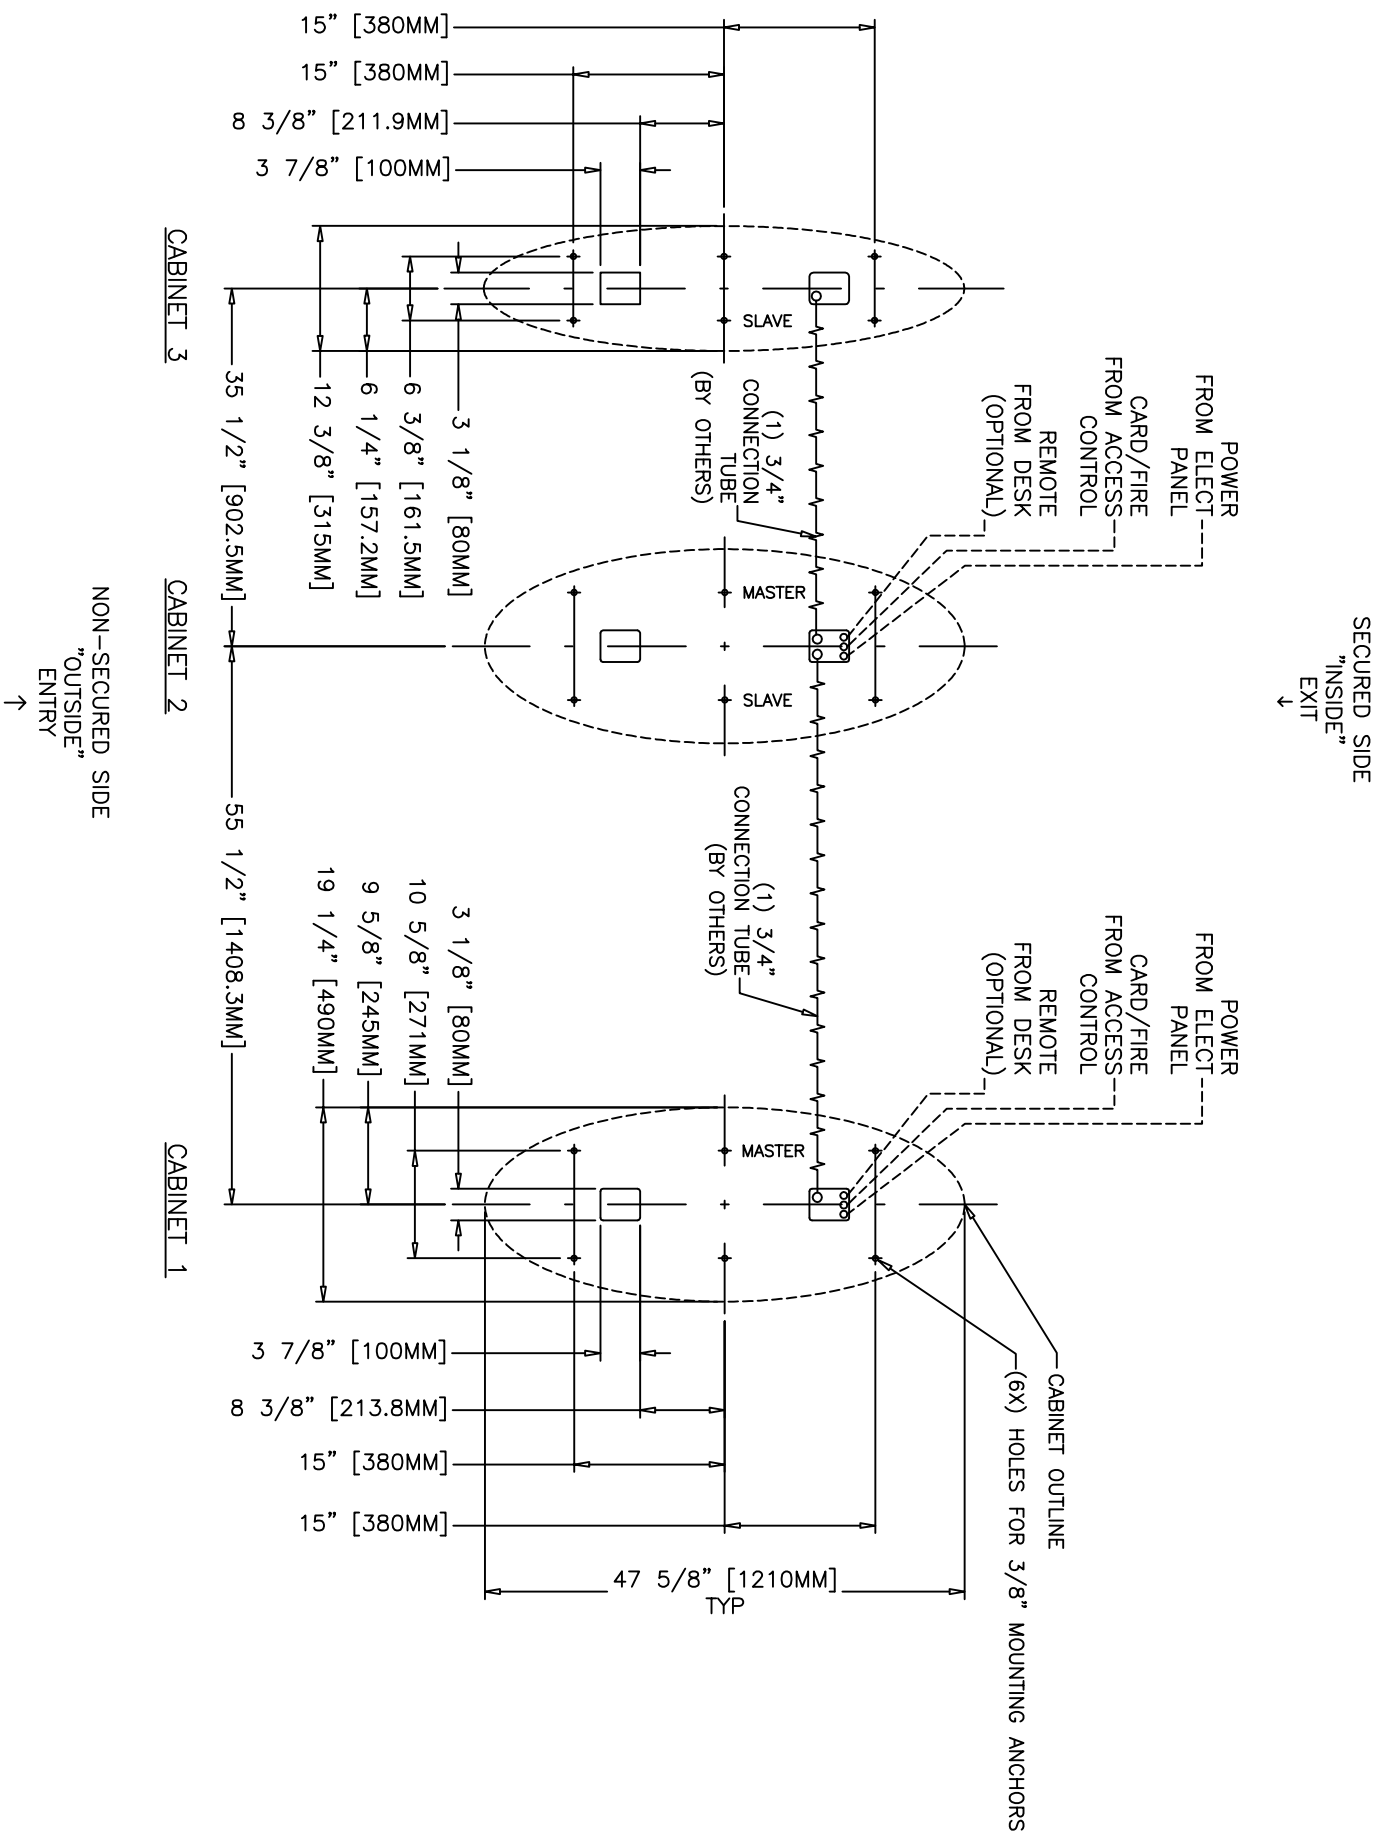

REV	DESCRIPTION	PAGE	DATE
A	REVISE CONDUIT SCHEME	2 OF 2	07/11/13 JB
.	SUBMITTAL	2 OF 2	09/17/12 EM

REVISION LOG

SL-300: 2 LANE ARRAY; 1 STD 1 ADA

Project: -  
Architect: -  
Customer: -

Job #: -  
Contractor: -

Date: 07/11/13 JB  
Rev: A



402 McKinney Parkway, Lillington, NC 27546 - (910) 814-8100 www.boonedam.us

1A

Scale: 3/4" = 1'