



SECURED SIDE  
"INSIDE"  
EXIT  
↓

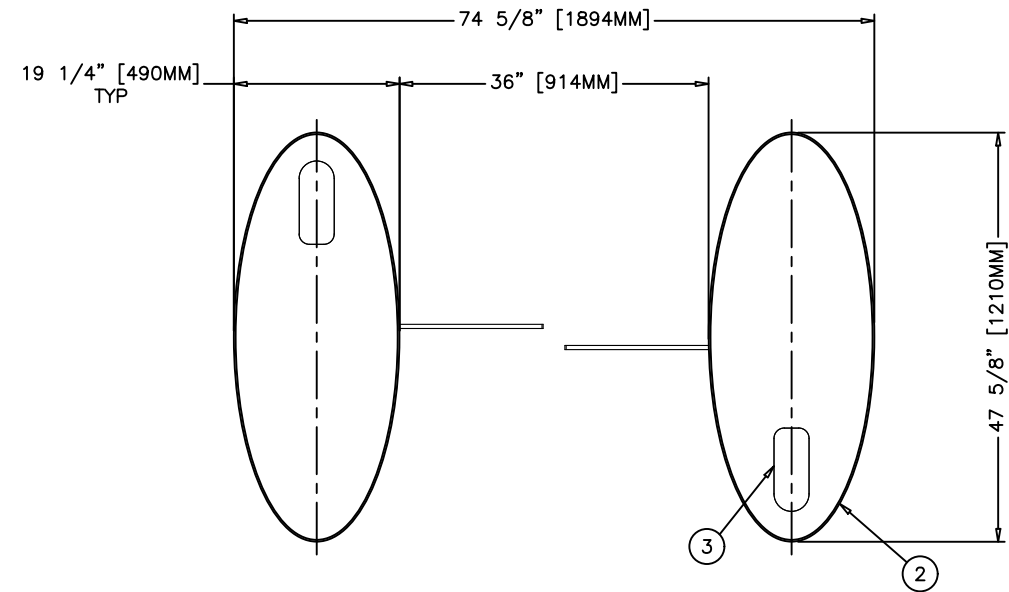

NON-SECURED SIDE  
"OUTSIDE"  
ENTRY  
↑

① PLAN VIEW

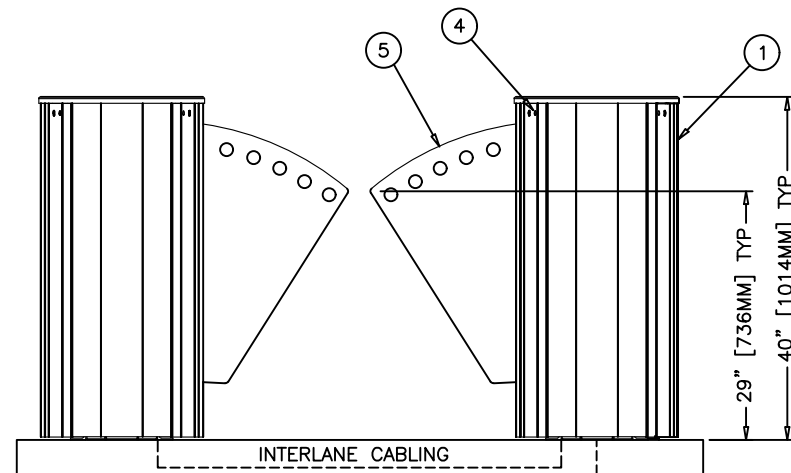

- CARD FROM ACCESS CONTROL
- FIRE FROM ACCESS CONTROL
- POWER FROM ELECTRICAL PANEL
- REMOTE FROM DESK (OPTIONAL)

② ELEVATION VIEW

**GENERAL NOTES:**

UNIT INSTALLS ON FINISH FLOOR.  
UNDERGROUND WIRING CONDUIT REQUIRED.  
OPTIONAL PLATFORM AVAILABLE.

FLOOR MUST BE DEAD LEVEL.

UNIT IS FREE STANDING – NO VERTICAL STRUCTURAL SUPPORT REQUIRED.

**ELECTRICAL NOTES:**

POWER SERVICE REQUIRED:  
110V-200V 50/60HZ, 15A, NEUTRAL, GROUND

AUTHORIZATION REQUIRES DRY CONTACT FROM ACCESS CONTROL.

ALL CONDUIT BY OTHERS.

**CODED NOTES:**

1. CABINET – #4 STAINLESS STEEL
2. TOP – #4 STAINLESS STEEL
3. TRAFFIC LIGHT/CARD READER WINDOW
4. SENSOR WINDOW
5. ACRYLIC PANEL BARRIER
6. CARD IN / CARD OUT

REV	DESCRIPTION	PAGE	DATE
A	SUBMITTAL	1 OF 2	7/18/19 MR

REVISION LOG

SL300W: 1 LANE ARRAY: 1 ADA

Project: PRODUCT CUTSHEET

Architect:

Customer:

Job #: CUTSHEET


Contractor:

Date: 7/18/19 MR

Rev: A

**BOON EDAM**

402 McKinney Parkway, Lillington, NC 27546 - (910) 814-3800 www.boonedam.us

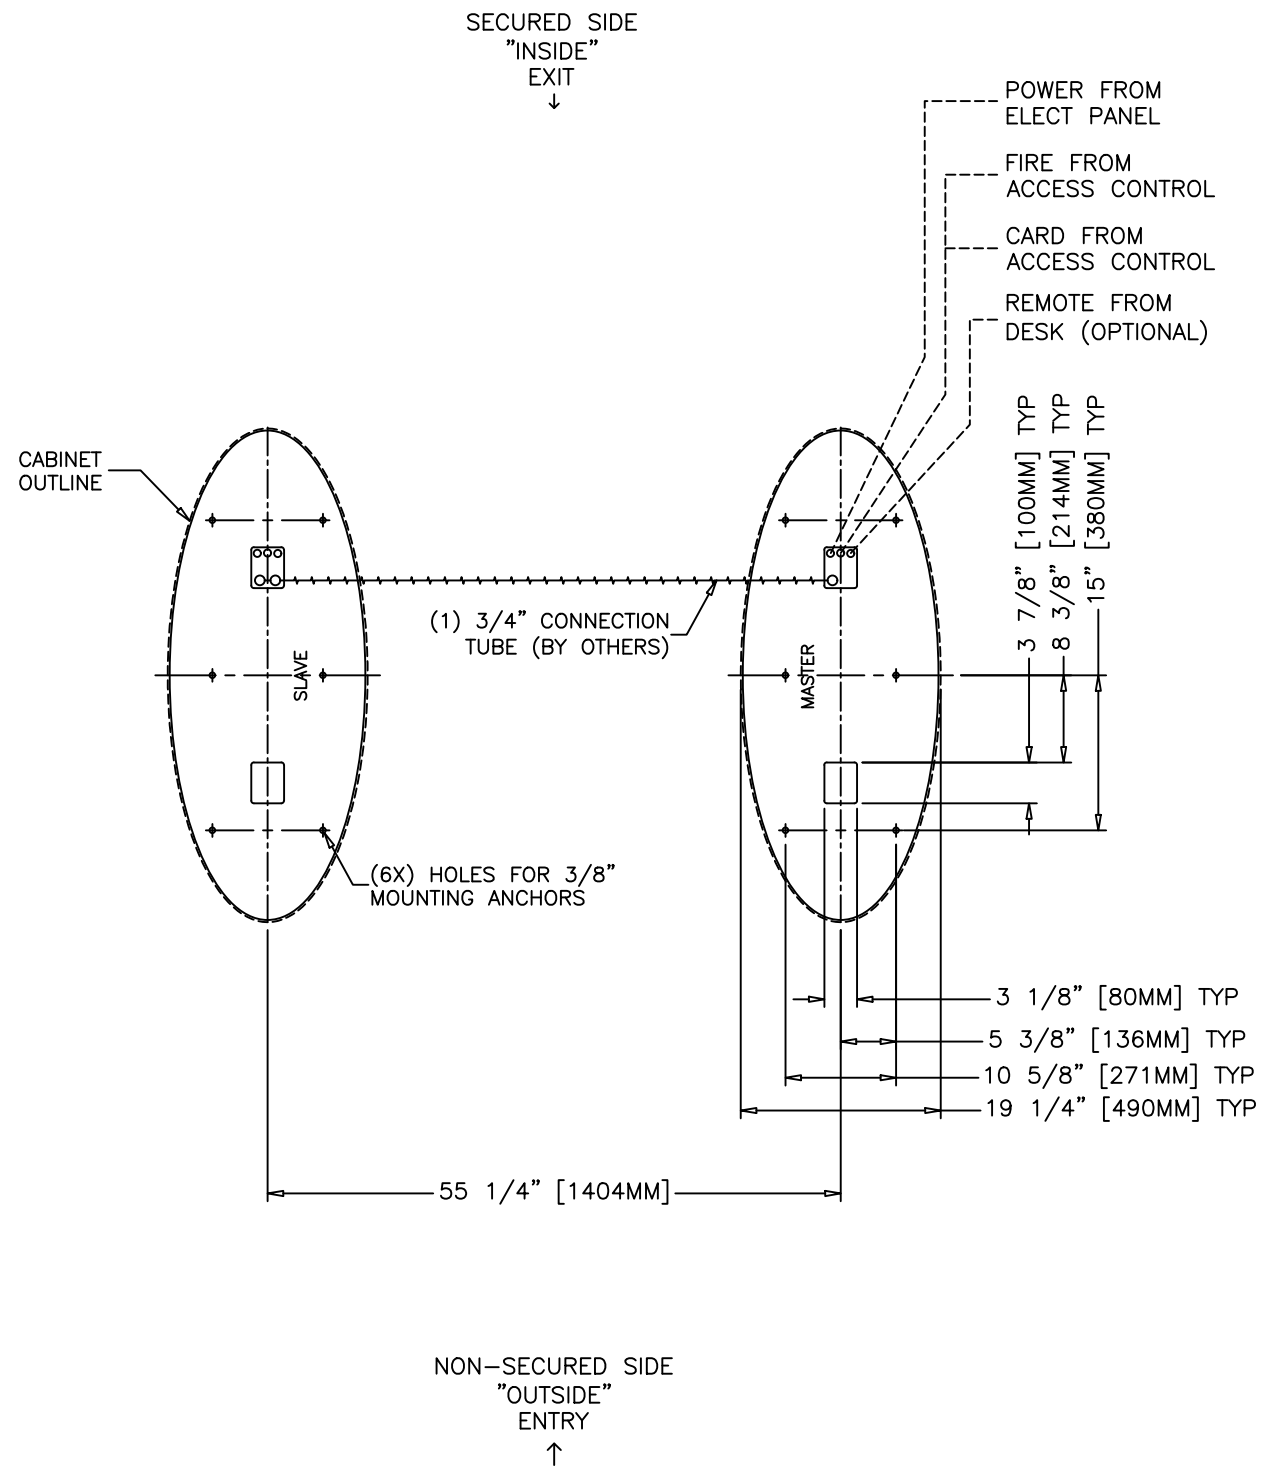

**ELECTRICAL NOTES:**

POWER SERVICE REQ'D:

110VAC OR 220VAC (1) PHASE 50/60HZ, 15A, NEUTRAL,  
GROUND MAX 1/2" [13mm] CONDUIT STUB UP

ALL CONDUIT BY OTHERS

REV	DESCRIPTION	PAGE	DATE
A	SUBMITTAL	2 OF 2	7/18/19 MR

REVISION LOG

SL300W: 1 LANE ARRAY: 1 ADA  
Project: PRODUCT CUTSHEET  
Architect:  
Customer:

Job #: CUTSHEET  
Contractor:

Date: 7/18/19 MR  
Rev: A

**BOON EDAM**

402 McKinney Parkway, Lillington, NC 27546 - (910) 814-3800 www.boonedam.us

1A